



Axis AX Single Loop Fire Alarm Control Panel

The AX-CTL-1C is a small, compact single-loop fire alarm control panel for use in cost-sensitive fire alarm installations, where fewer than 126 addressable points are required. The panel contains the same features as the Advanced AX-CTL-1L, AX-CTL-2 and AX-CTL-4 intelligent fire alarm control panels but in a smaller, compact enclosure.

As part of the Axis AX range, the AX-CTL-1C can be easily used in larger applications due to its optional peer-to-peer networking capabilities.

Designed with installation and service engineers in mind, the AX-CTL-1C is modularly packaged, using surface mount and dual flash microprocessor technology, with onboard real-time clocks for ease of installation, troubleshooting, programming and maintenance.

The AX-CTL-1C provides a single Class X, A or B signalling line circuit (SLC). Communication to the field devices attached to the SLC is via an advanced, 100% digital protocol which has the advantages of being highly immune to noisy environments. The SLC supports up to 126 analogue-addressable devices (any combination of intelligent detectors, input and/or output devices, including loop-powered technology devices). In addition, unique sub-addressing of various input and/or output devices is permitted to expand on the overall AX-CTL-1C system capacity.

The AX-CTL-1C comes with two filtered, voltage-regulated notification appliance circuits (NACs), Class A or B, each rated 2 Amp @ 24 VDC. Due to exceptional regulation and high rating, the onboard NAC outputs provide compatibility with most listed notification appliance devices.

The AX-CTL-1C has resettable and non-resettable power outputs; each rated 0.5 Amp @ 24 VDC for connection to four-wire conventional smoke detectors and/or ancillary devices. Each AX-CTL-1C contains three field-programmable, Form "C" relay contacts rated 1 Amp @ 30 VDC, defaulted as a fail-safe trouble relay, alarm relay and supervisory relay.

Simplifying and reducing initial system set-up, each AX- CTL-1C panel is equipped with an installer-friendly "auto-learn/loop detection" feature that permits the rapid recognition of all signalling line circuit devices. This rapid recognition simplifies the immediate assignment of critical life safety functions. Assignments include: intelligent detector type and operation criteria, addressable input device recognition as an alarm input and addressable output control on a general alarm basis.



Features

- 126 analogue-addressable points
- Advanced user interface w/graphical LCD
- "DynamiX" I/O relationship programming
- Synchronised audible and visual NAC circuits
- Superior service & maintenance diagnostics
- Peer-to-peer networking
- Automatic drift compensation per detector
- Automatic detector testing with maintenance alert
- Alarm verification and PAS.
- Class X, A or B SLC operation (supports loop-powered technology)
- Class A or B NAC circuits
- Voltage-regulated NACs (compatible with most listed NAC devices)
- Multi-pattern and two-stage NAC control

Version [REV3] Page 1 of 5

Designed with built-in powerful installation and customisation tools, the AX-CTL-1C can adapt to virtually any application requirement. With Dynamix programming, time-consuming complexities associated with I/O relationship programming such as two-stage multi-pattern NAC control, intelligent detector drift compensation, precision response/sensitivity mode settings, flexible timing functions and more are significantly reduced.

The AX-CTL-1C is fully field programmable via the onboard graphical LCD display and alphanumeric keypad. Front panel programming may encompass defining input to output relationships, configuring output circuit characteristics, entering zone, device, and other text descriptions, and configuring multiple user-access level passwords.

To maximise the capability and flexibility of the single loop fire alarm control panel, the standard Advanced Windows-based PC-NeT field configuration tool is compatible with the AX-CTL-1C. The PC-NeT field configuration tool is a powerful, user-friendly programming tool that allows users to perform virtually any I/O relationship with multiple criteria. Simple drop-down menus with point-and-click operation make project commissioning and troubleshooting fast and efficient.

The AX-CTL-1C can accommodate remote graphical LCD annunciators (with or without system control capabilities) on the Ad-NeT- PluS peer-to-peer network. Multiple annunciator locations can be created based on installation demands. These locations can have either: no system control, partial system control, or full system control. When installations exceed a single panel's capacity, the Advanced Ad- NeT-PluS peer-to-peer network can be implemented, providing up to 200 network nodes. The Ad-NeT-PluS is completely field programmable for inter-panel functionality or segregation of information and control based on installation requirements.

Features (continued)

- Network-wide audible and visual synchronisation
- "Auto-learn/loop detection" programming
- Built-in intelligent multi-meter

Listings and Approvals

- Certified to UL864 10 th Edition File No. S35979
- CSFM Approved: Pending
- NYCFD COA: Pending

Designed with the technician in mind, each module of the AX-CTL-1C single loop fire alarm control panel is easy to install and service.

The integral power supply offers status LEDs, temperature-compensated charging, and the ability to operate directly from the batteries when AC supply is not yet available at the installation site. A unique built-in intelligent multi-meter allows technicians to interrogate any input and/or output and diagnose potential time consuming trouble issues with virtually no complications or aggravation.

Craphical Liquid Crystal Display Navigation Buttons Dec Add Advanced Oct 28 2013 IOPRIAL PROBLE OPERATION (Press Phena to Usau) Axis The ind but corr LED Status Indicators Control Buttons 12 Button Keypad (Numbers & Letters)

Advanced User Interface w/Graphical LCD:

Designed to be user-friendly and easy to operate, the Advanced User Interface w/Graphical LCD (backlit 240 x 64) is the information and control center for the AX-CTL-1C single loop fire alarm control panel.


The unit incorporates a graphical LCD display, LED status indicators, control buttons (including 3 programmable buttons), navigation buttons, and a 12 button keypad for complete system status, interrogation, and control.

Version [REV3] Page 2 of 5

Button (Keys)		
9	Reset	
\bigcirc	Ack (panel buzzer acknowledge)	
	Resound (resound signals)	
\otimes	Silence (silence signals)	
®	Fire Drill	
	Function Keys (3 - programmable control buttons)	
(-\display-)	Navigation Keys (up, down, left, right, and tick [enter])	
666 666 666 666 666	12 Button Keypad (numbers, letters, esc, and menu)	

LED Indicators	
Alarm	Red
Pre-Alarm	Red
Disable	Yellow
Test	Yellow
P.A.S.	Yellow
Power	Green
Supervisory	Yellow
NAC Silenced	Yellow
NAC Trouble	Yellow
NAC Disabled	Yellow
System Trouble	Yellow
Programming	Yellow
Programmable LED 1	Red
Programmable LEDs 2-5	Yellow

Wiring Diagram

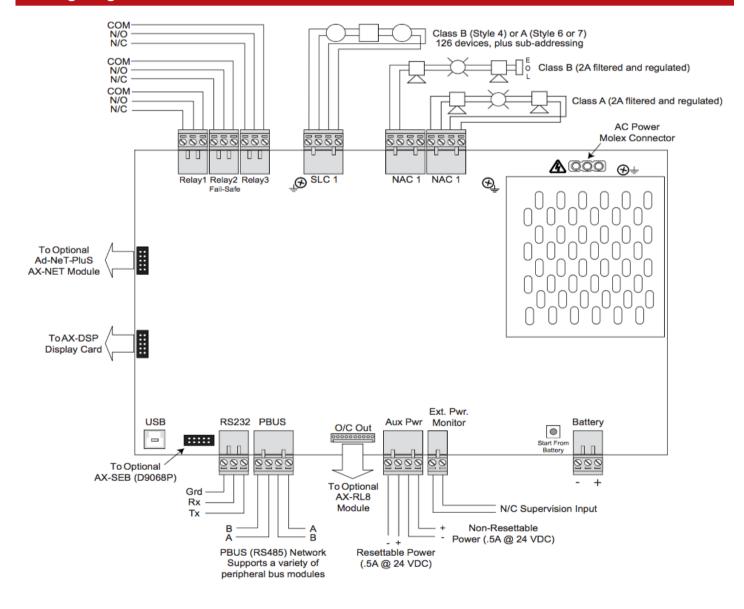

Version [REV3] Page 3 of 5

Operating Voltage	120 VAC (1.4A) - 240 VAC (0.7A), 50/60Hz
System-Brown-Out	98 VAC nominal
Battery Circuit Charging Voltage Temp. Compensated Charging Current Battery Derating Factor Battery Capacity Battery Fuse	27.4 VDC nominal* 2.3 Amp 0.83A 7 Ah (minimum), 75 Ah (maximum) 5A @ 240 VAC, time delayed, ceramic, high breaking (in-line wire link)
Fire, Supervisory, and Trouble Relays Type Rating Trouble Relay	(Power limited - when using system power) Form "C" 1A @ 30 VDC/VAC Normally active (fail-safe operation)
Auxiliary Power Outputs Resettable Voltage Current Reset Time Non-Resettable Voltage Current	(Power limited) 24 VDC 0.5A 10-15 seconds 24 VDC 0.5A
Humidity	85% RH
Temperatures Operating Recommended Room	32 °F - 120 °F (0 °C - 49 °C) 60 °F - 86 °F (15 °C - 27 °C)
Enclosure Dimensions	17 7/8"H x 14 3/4"W x 5 5/8"D
SLC Loop Class (Style) Voltage Minimum Return Voltage Current	(Power limited) Class X, A or B 24 VDC 17 VDC 0.5A
NAC Circuits Class (Style) Voltage Minimum Return Voltage Current Maximum Voltage Drop Maximum Line Impedance	(Power limited) Class A or B 24 VDC (filtered and regulated) 16 VDC 2A (each) 3 VDC 1.5Ω
RS232 Baud Rate Parity Data Bits Stop Bits	Supervised, optically isolated 9600 None 8 1
Base Card Operating Current AX-CTL-1PCB	Quiescent Alarm 110 mA 195 mA

Refer to individual Axis AX Series module data sheets for specific specifications regarding optional modules.

Version [REV3] Page 4 of 5

^{*}For use with listed/compatible product

Order Codes and Options			
AX-CTL-1C*	Single-Loop Fire Alarm Control Panel with power supply/charger, 1 SLC, 2 NACs, 3 auxiliary relays (enclosure supports batteries 7Ah - 18Ah)		
AX-1C-BP*	Optional Battery Cover (Dress) Plate		
AX CTL Base Card Option Modules**:			
AX-NET4	Network Interface Card Class B		
AX-NET7	Network Interface Card Class X(A)		
AX-RL8	8-Way Relay Output Card (Programmable)		
AX-UCM3	Advanced Contact-ID and SSIA Digital dialler, requires AX-SEB2		
AX-SEB2	Serial Expansion Board for use with AX-UCM3		

^{*} For grey enclosure, add the suffix "G" to the part number.

Check if this document is up to date | Give us feedback

Advanced, The Bridges, Balliol Business Park, Newcastle upon Tyne, NE12 8EW, UK T: +44 (0)345 894 7000, E: enquiries@advancedco.com, W: www.advancedco.com

As our policy is one of constant product improvement the right is therefore reserved to modify product specifications without prior notice.

Version [REV3] Page 5 of 5

^{**} Refer to individual Axis AX module data sheets for peer to peer network and peripheral bus optional modules.